
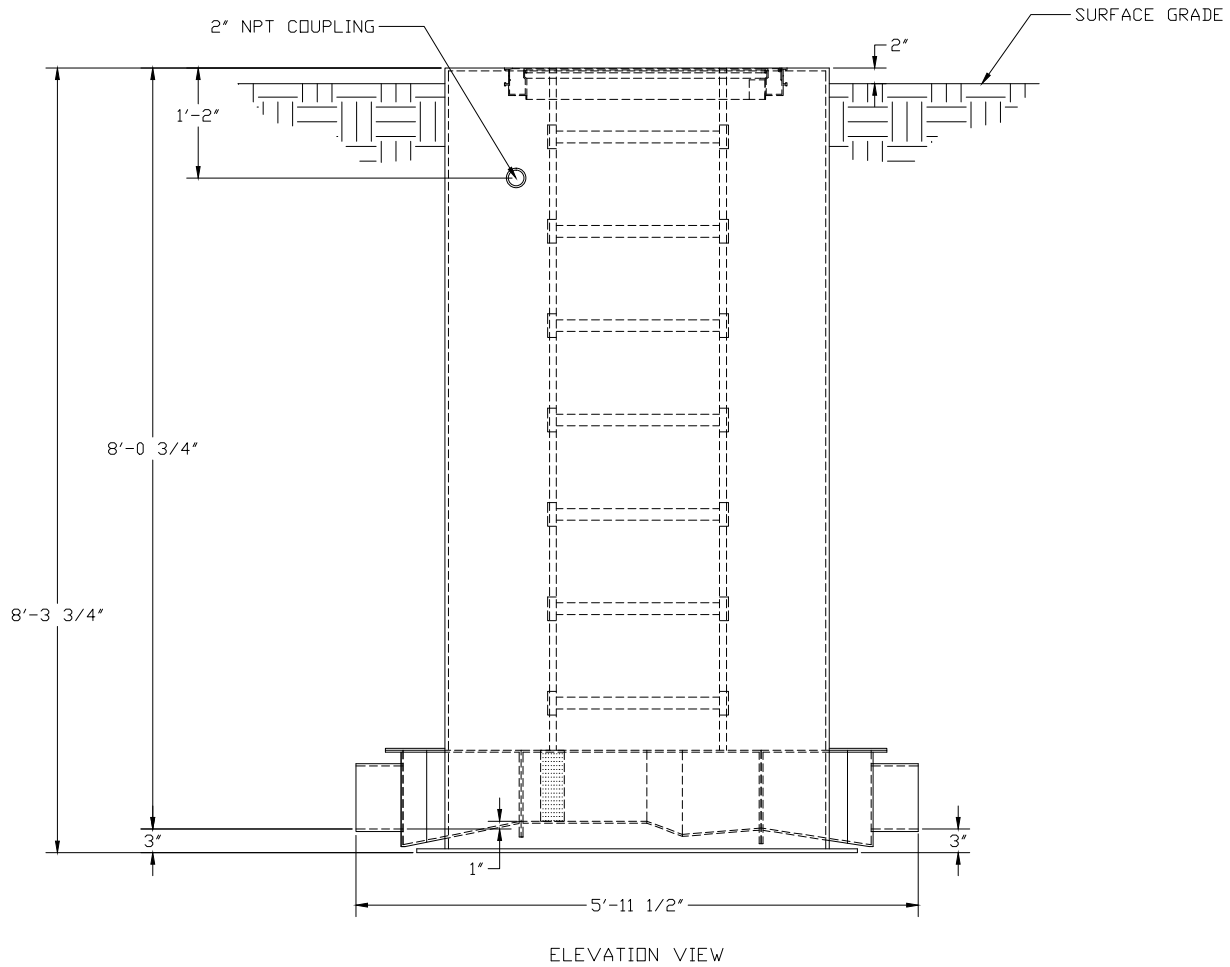


TRACOM ORDER NO.:	16318
CUSTOMER / P.O. NO.:	HD SUPPLY - 5833883
WORK ORDER NO.:	P16318-A

FLOW METER:	ULTRASONIC - (BY OTHERS)
CONNECTION:	8" DIA. C.I./PVC PIPE
ACCESSORIES:	STAFF GAUGE (AD/ENGLISH)

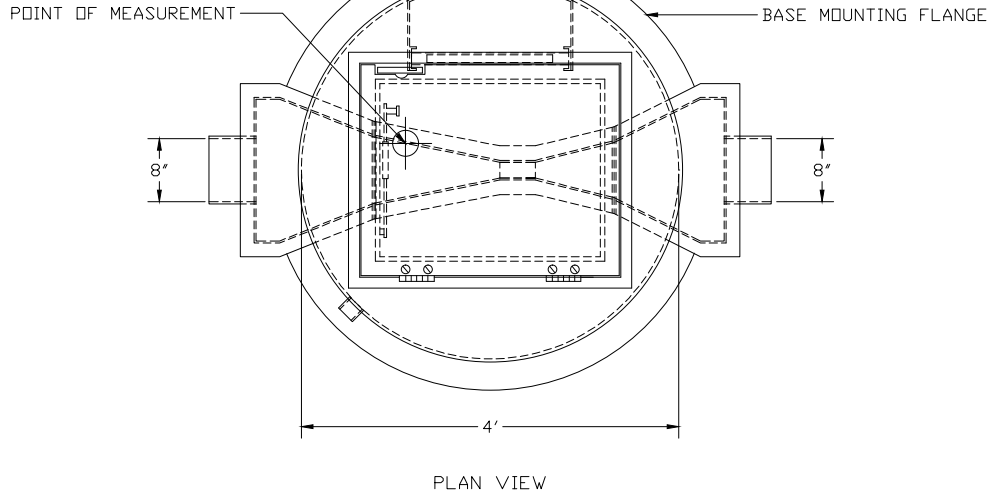

- 1) FLOW IS FROM LEFT TO RIGHT
- 2) ANCHOR BOLTS BY OTHERS
- 3) ALUMINUM HATCH ENGRAVED WITH "WASTEWATER FLUME ASSEMBLY"
- 4) 2" PARSHALL NOT FOR USE ON UNSCREENED SANITARY FLOWS

**TRACOM**  
FIBERGLASS PRODUCTS

METERING MANHOLE, 48 INCH DIA., ALUMINUM HATCH STYLE, 30" W X 24" D NON-WATERTIGHT HATCH, WITH 2" PARSHALL FLUME, 8" PIPE STUBS, AND STAFF GAUGE (TENTHS) (RIGHT)

DWG. NO. MH-48-ALNWT30X24-PAR02-P8-N-ER-N-N-N REV 0

PROJECT

WILLIAM JAMES MIDDLE SCHOOL  
ON-SITE SEPTIC SYSTEM

DATE 8/7/12